Bank of America – MPTS Performance Data upon commissioning.
HVAC loads are not ON a system – weather is still in the 50s.


The wasted energy is almost zero.
PF refers to Power Factor and in common language efficiency or power used versus power supplied by the utility
99.999 percent utilization of power delivered to the building.







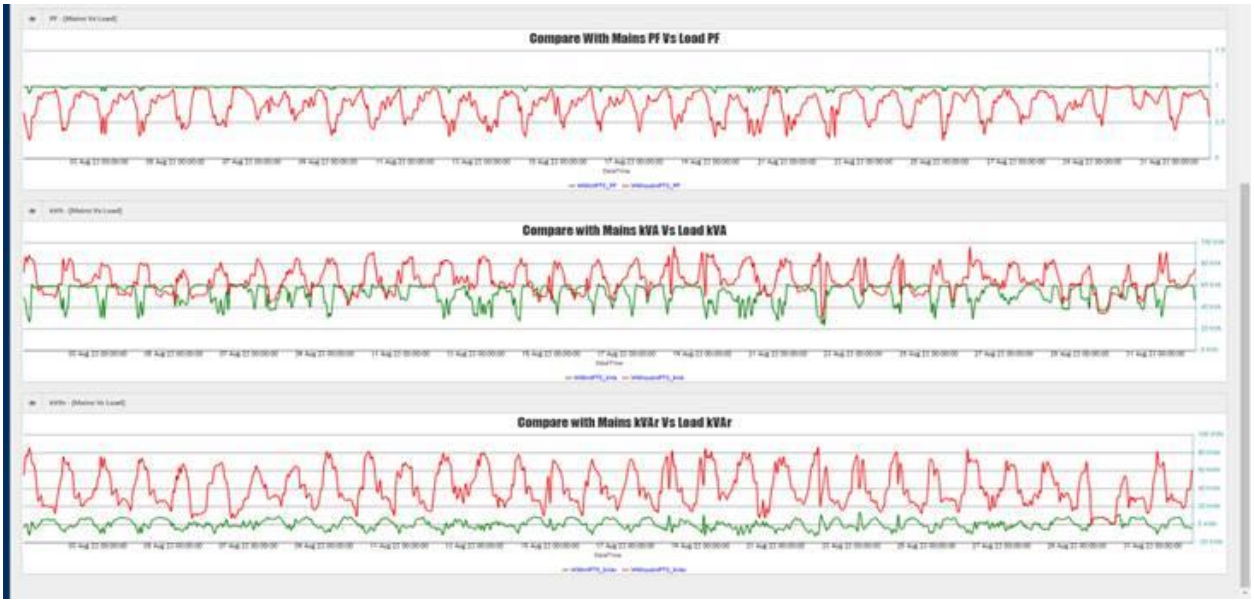


Compare With Mains PF Vs Load PF
Compare with Mains kVA Vs Load kVA
Compare with Mains kVAr Vs Load kVAr


Bank of America


TransPower Company
Saving Energy and Our Environment
Calendar 21- Apr -24
Clock 13:11:14
Mains PF 0.999
Load PF 0.949
Mains Current 504.4
Load Current 531.2
MPTS KVAR 129.3
MPTS Current 154.7
PT Sequence ABC
CT Reversal Nil
Alarm Nil
DG Off
Bank 1 2 3 4
Alarm Ackl
MONITOUCH